


AN 153 URD or ND TYPE DAMPERS WITH ND3-B MOTOR ACTUATOR WIRING DIAGRAM

ANY HEAT/COOL THERMOSTAT WITH SUB-BASE

RECOMMENDED CONFIGURATION

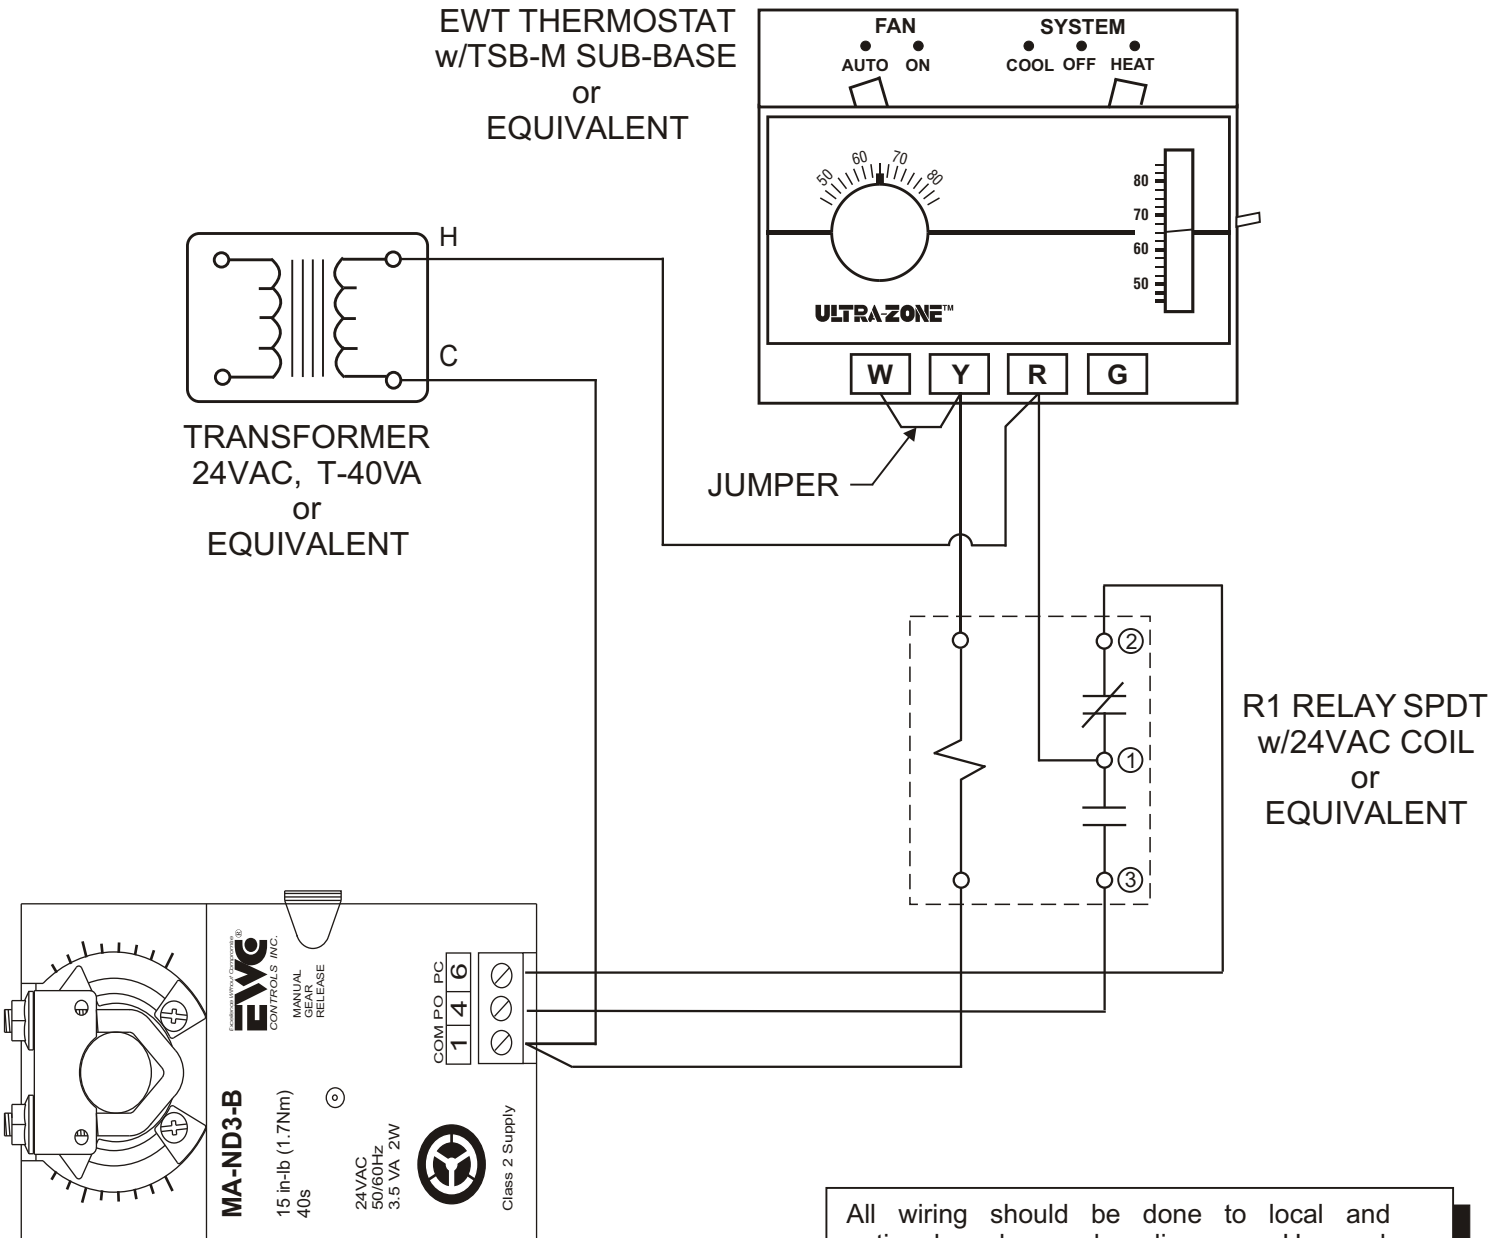

All wiring should be done to local and national codes and ordinances. Use color-coded multi-conductor wire. 18 AWG solid copper wire.